

Installation Instructions


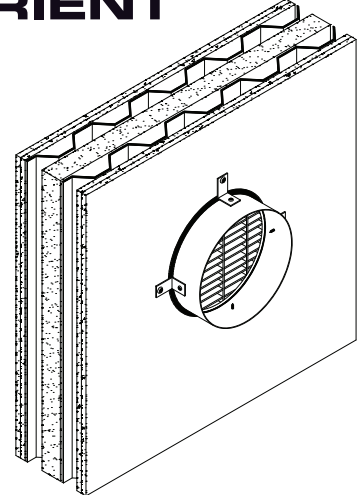
- Circular dampers in Security wall

1. Position and centre the spigot containing fire damper in the penetration aperture as per system drawing
2. Fasten supplied mounting tabs to exterior of spigot with steel self drilling screws or steel pop rivets).
3. Fix mounting tabs to Security wall using min 60mm long self drilling steel screws (supplied by others). Ensuring that they engage with steel liner)
4. Fire-stop any gaps between the damper & building element with LORIENT Intumescent Mastic (supplied separately). Ensure mastic fill depth corresponds with those detailed in the System Drawing.
5. If connecting ductwork to installed damper ensure that an appropriate AS1682.2 compliant breakaway joint method is used.
6. Ensure product and certification labels are in a prominent position for easy identification during subsequent maintenance inspections.
7. Ensure convenient access is provided for visual inspection and cleaning as necessary.

Notes

1. Product must be fitted in accordance with this detail, including the use of LORIENT Intumescent Mastic to ensure compliance with LORIENT Fire Test Approval detailed.

Ph 1300 858 010 www.lorient.com.au

Building Element	CSR Security wall
Application	Steel sleeve in penetration
Maximum Size	300mm diameter
FRL	-/ 90 /-
Test Reference No.	WFRA 45955
System No.	WS2